
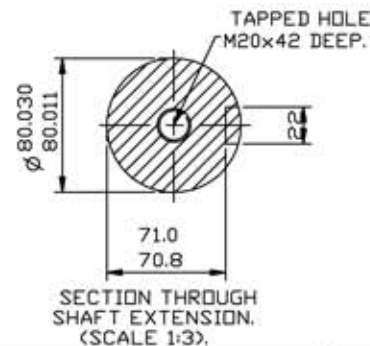


2 LIFTING LUGS
DIAGONALLY
OPPOSITE.

THIS LIFTING LUG
FITTED ONLY
WHEN MOTOR IS
VERTICALLY MOUNTED.

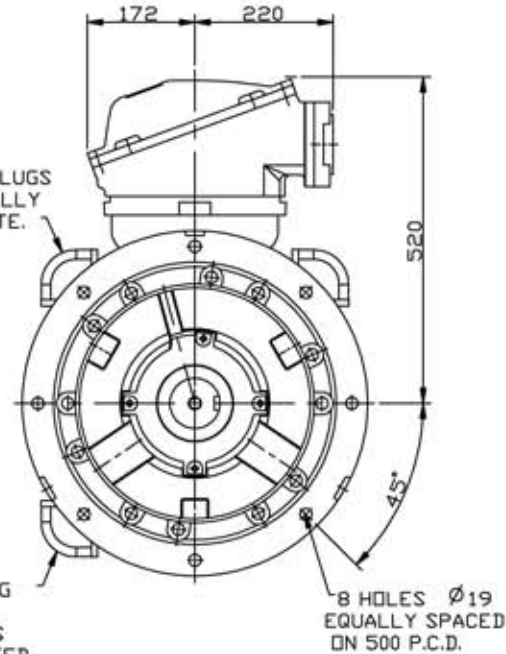

NOTE1
CABLE ENTRY CAN BE SUPPLIED
IN ANY ONE OF FOUR POSITIONS
AT 90° INTERVALS.

NOTE1
STANDARD MACHINES ARE ARRANGED FOR HORIZONTAL OVERHUNG MOUNTING.
CUSTOMERS SHOULD NOTIFY US WHEN ORDERING IF VERTICAL MOUNTING
IS REQUIRED. IF VERTICAL, THE MOTOR THRUST BEARING MUST NOT BE
ALLOWED TO TAKE ANY LOAD OTHER THAN THE WEIGHT OF THE ROTOR
WITHOUT OUR APPROVAL.

OUTLINE DIMENSIONS OF STANDARD FLANGE MOUNTED METRIC
MOTOR TO BS4999 PART 141. EEx de TO EN50014/18/19.
TOTALLY ENCLOSED FAN VENTILATED.
FRAME SIZE: W-EF280S-D (4 POLE UP).

SCALE	1:8	DATE	19.4.00
DRAWN	LM		
CHECKED	J.M.L		
APPROVED	J.M.L		

CUSTOMER	
ORDER No.	
SERIAL No.	
FRAME SIZE	
KW	R.P.M.
Hz	PHASE 3
VOLTS	POLES
BRGS.	D.F. N.D.F.
MOTOR NETT. WT.	Kg.
INSULATION CLASS	
TEMPERATURE RISE °C	
DESIGN AMBIENT TEMPERATURE °C	
HEATER WATTS & VOLTS (IF FITTED) WATTS, VOLTS	

REMARKS
EEx de IIB
BASEEFA CERTIFICATE
No. Ex99E1042X.

or
EEx de IIC
BASEEFA CERTIFICATE
No. Ex99E1043X.

ALL DIMENSIONS IN MILLIMETRES



FIRST ANGLE
PROJECTION

NOTE1
2.5 ENDPLAY WILL BE PROVIDED FOR ENDTHRUST
PROTECTION WHEN CUSTOMERS NOTIFY US OF THEIR
INTENTION TO USE RIGID COUPLINGS AND DRIVEN
MACHINES WITHOUT ENDPLAY.

DRG. No.

M70318

REVISION: DATE